



# Certificate of Test

No. 2970

“Copyright CSIRO 2017 ©”  
 Copying or alteration of this report  
 without written authorisation from CSIRO is forbidden.

This is to certify that the element of construction described below was tested by CSIRO Infrastructure Technologies in accordance with Australian Standard 1530, Methods for fire tests on building materials, components and structures, Part 4 Fire-resistance tests of elements of construction, 2014 on behalf of:

Boss Products (Australia) Pty Ltd  
 Unit 8, 15-23 Kumulla Rd  
 Caringbah NSW

A full description of the test specimen and the complete test results are detailed in the Division's Sponsored Investigation report numbered FSP 1833.

Product Name: Penetration 4 – FireMastic-300 sealant protecting a 150-mm wide cable tray with 60 cables lagged with Boss P40-MAK Wrap.

Description: The Sponsor identified the specimen as a plasterboard wall system comprised of Boral Firestop 16-mm plasterboard both sides (with an established FRL of -/90/90) with FireMastic-300 sealant protecting a 150-mm wide cable tray with 60 cables lagged with Boss P40-MAK Wrap. The cables are described as a bundle of 60 cables (each cable approximately 14-mm in diameter) secured on a 150-mm cable tray. The services penetrated 500-mm from the exposed side and 800-mm from the unexposed side, measuring 60 x 50 pair, 0.5-mm (as per Appendix D2 – AS 1530.4). Cables on both the exposed and unexposed side were left untreated. The pipe was supported approximately 500-mm away from the wall on the unexposed face. The FireMastic-300 sealant, manufactured by Boss Fire & Safety Pty Ltd, is described as an intumescent Fire-Rated one part acrylic emulsion sealant. The Boss P40-MAK manufactured by Boss Fire & Safety Pty Ltd, is described as a mineral fibre lagging 38-mm thick with a density of 40-kg/m<sup>3</sup> wrap and foil lining on one side. A surface seal around the cable tray was created with a 50mm fillet of FireMastic-300 sealant on the exposed and unexposed face. Boss P40-MAK wrap was wrapped twice around the cable tray on both sides of the wall (to a thickness of approximately 40-mm) which was secured with steel wire and foil tape. The wrap extended 300-mm from the both sides of the wall, flush with the FireMastic fillet. For a detailed description, refer to drawing titled CSIRO 0517 – 05 dated 26/05/17 by Boss Fire & Safety.

Structural Adequacy	not applicable
Integrity	no failure at 91 minutes
Insulation	no failure at 91 minutes

and therefore for the purpose of Building Regulations in Australia, achieved a fire-resistance level (FRL) of -/90/90.

The fire-resistance level of the wall system is applicable when the system is exposed to fire from either direction. The fire-resistance level (FRL) are limited to that of the separating element. This certificate is provided for general information only and does not comply with regulatory requirements for evidence of compliance.

Testing Officer: Heherson Alarde Date of Test: 9 May 2017


Issued on the 20<sup>th</sup> day of June 2017 without alterations or additions.

Brett Roddy  
 Manager, Fire Testing and Assessments

	This document is issued in accordance with NATA's accreditation requirements. Accreditation No. 165 – Corporate Site No. 3625 Accredited for compliance with ISO/IEC 17025 - Testing
--	--

**Component Summary:**

- (1) Plasterboard, 16mm fire-rated
- (2) BOSS FireMastic-300 seal, 50mm surface fillet
- (3) Telco cables, 60 x 50 pair  
100 wires, each wire 0.5mm OD  
(Appendix D2 - AS1530.4)
- (4) Cable tray, 150mm wide
- (5) BOSS P40-MAK Wrap, single layer  
300mm from either side of wall.

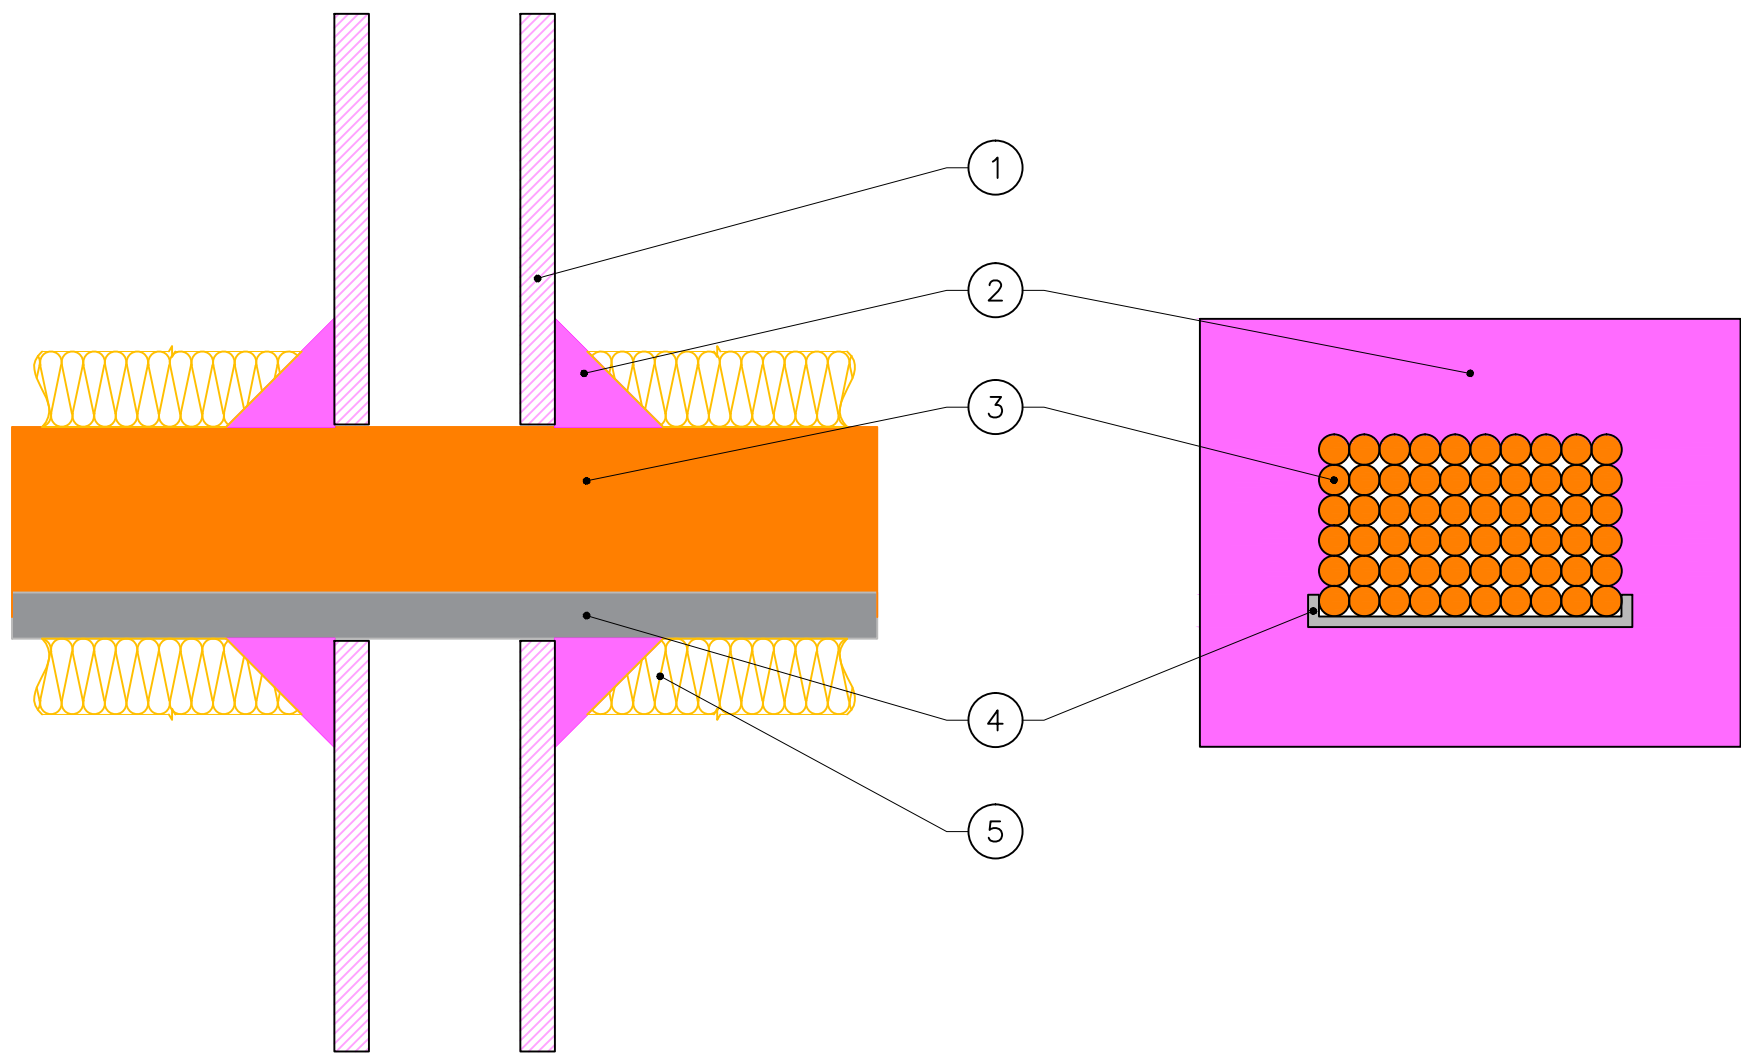



**Sales & Technical Support**  
 Ph: 1300 502 677  
[www.bossfire.com.au](http://www.bossfire.com.au)

Drawing Title	
Telco Cables Penetrating 90min Wall	
Description	
FireMastic-300 Surface Seal	
Test Ref	
CSIRO 0517	
Date of Issue	
26 May 2017	
Drawing Number	Drawn By
CSIRO 0517 - 05	SL